



**Separation of Attached Residential Garage
Shasta County
Department of Resource Management
Building Division**

1855 Placer Street, Suite 102 Redding, CA 96001-1759
(530) 225-5761 * Fax (530) 245-6468


Handout

119

01/08

Page 1 of 1

(2007 CBC – Permit applications submitted on or after January 1, 2008)

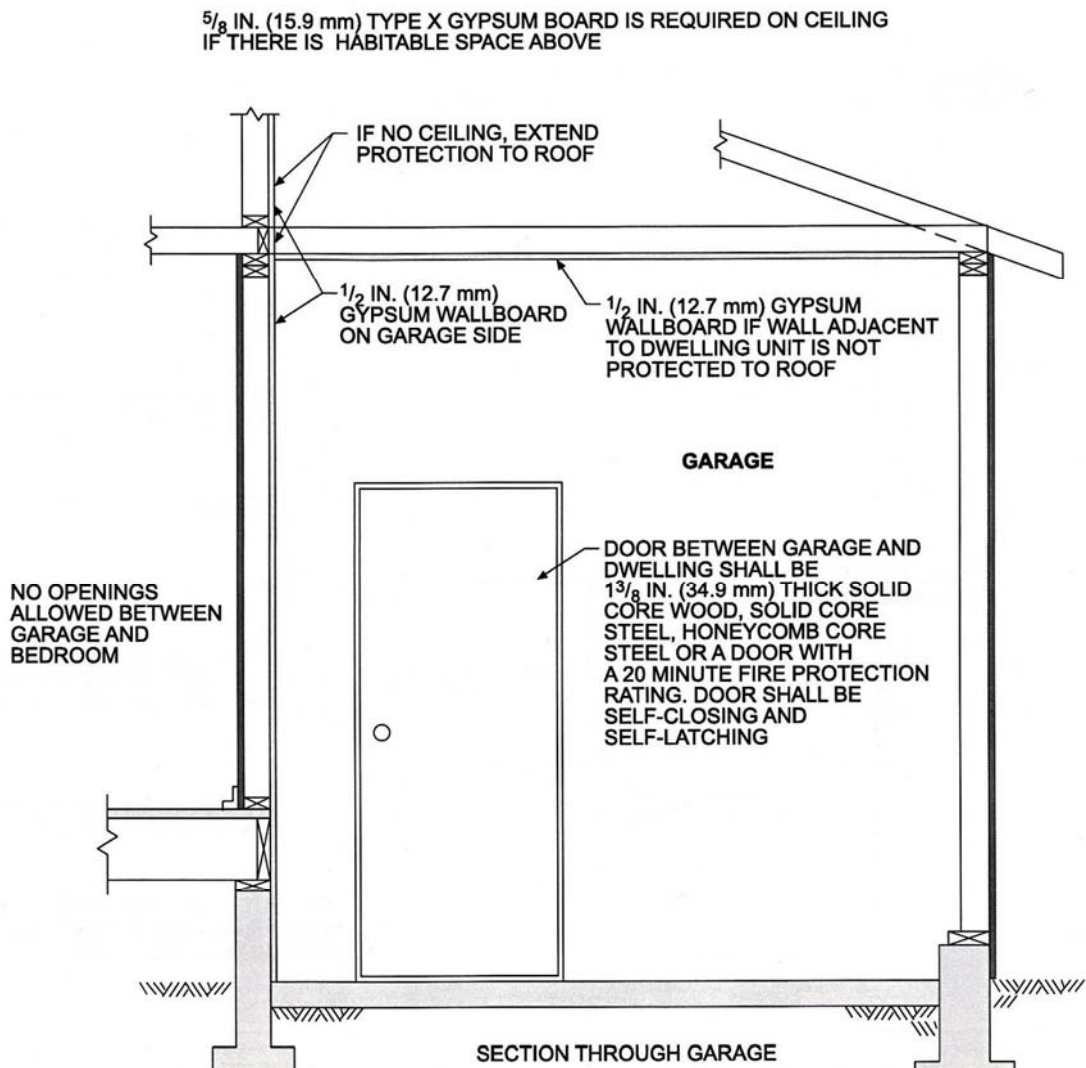

- 1) Ducts in the garage that penetrate the separation must be a minimum of 26-gauge steel with no openings in the garage.
- 2) Horizontal attic access through the required separation will require a door as specified above or a plywood backed sheetrock hinged access panel with a handle on the attic side so installed that it will remain closed. For example, positioned so that when it is opened, it will not pass vertical and close when released.